



Republic of the Philippines
COMMISSION ON AUDIT
Regional Office No. IX
Cabatangan Hills, Zamboanga City

BIDDER’S CERTIFICATION

This is to certify that I have received from the canvasser of the Commission on Audit, Regional Office No. IX, this City, a copy of Canvass/Bid No. 23 – 09 – 002 dated September 4, 2023 as indicated by my signature hereunder.

Bidder/Dealer	Print Name	Signature	Date	Tel. No.

CANVASSERS’ CERTIFICATION

We hereby certify that we have delivered a copy of Canvass/Bid to be opened on September 8, 2023 / 9:30am to the above dealers or bidders.
(Date/Time)

CANVASSER

CANVASSER

WATER SUPPLY
PR No. 23-206 dated August 8, 2023

Republic of the Philippines
Commission on Audit
Cabatangan Hills, Zamboanga City –7000
Tel. No. 955-5883

Name of the Procuring Entity

PR No. : PR No. 23-206 dated August 8, 2023
WATER SUPPLY

Standard Form Number:SF-Good-60

Revised on : May 24,2004
Standard form Title: Requested for Quotation

Date: September 4, 2023
Quotation No. : 23-09-002

Company Name: _____

Address: _____

Please quote your lowest price on the item/s listed below, subject to the General Conditions on the last page, stating shortest time of delivery and submit your quotation duly signed by your representative not later than September 8, 2023, 9:30 AM _____. In the return attached herewith or at this email address: bacsec.coaro9@gmail.com

NOTE:

- 1. ALL ENTRIES MAY BE TYPEWRITTEN OR HANDWRITTEN
- 2. WARRANTY SHALL BE FOR A PERIOD OF SIX (6) MONTHS FOR SUPPLIES & MATERIALS, ONE (1) YEAR FOR EQUIPMENT, FROM THE DATE OF ACCEPTANCE BY THE PROCURING ENTITY.
- 3. PRICE VALIDITY SHALL BE FOR THE PERIOD OF _____ CALENDAR DAYS
- 4. PHILGEPS REGISTRATION CERTIFICATION/NUMBER & BUSINESS PERMIT SHALL BE ATTACHED UPON SUBMISSION OF THE QUOTATION
- 5. DETAILED ESTIMATES SHALL BE ATTACHED UPON SUBMISSION OF THE QUOTATION
- 6. VALID PCAB LICENSE SHALL BE ATTACHED UPON SUBMISSION OF THE QUOTATION

ABC66,142.12

No.	ITEM DESCRIPTION	QTY.	Unit	Unit Price	Total Amount
	WATER SUPPLY FOR REGIONAL DIRECTOR'S STAFF HOUSE, CANTEEN & OUTDOOR KITCHEN				
I	Cleaning of Existing Sump Tank & Stainless Steel Tank	1.00	l.s.		
II	Installation of Water Pump and its fittings	1.00	lot		
III	Steel Works	1.00	lot		
	Contract Duration: 15 Calendar Days				
	Location: COA ROIX, Cabatangan, Zamboanga City				

(Signature over Printed Name of Bidder)

(PhilGEPS Registration Number)



REPUBLIC OF THE PHILIPPINES
Commission on Audit
REGIONAL OFFICE NO. IX
 Cabatangan, Zamboanga City

Project: Water Supply for Regional Director's Staff House, Canteen and Outdoor Kitchen

Location: COA Regional Office IX, Cabatangan, Zamboanga City

Scope of Works

Part I Cleaning of Existing Sump Tank & Stainless Steel Tank

- Cleaning of Sump Tank must include declogging of overflow pipe and checking on the condition of the water supply line from the water district for possible leaks to be repaired
- Cleaning of existing elevated stainless steel tank

Part II Installation of Water Pump and its fittings

- Procurement and Installation of Water Pump to suction water from the Sump Tank to existing Elevated Stainless Steel Tank
- Tapping of Supply Line from Elevated S.S. Tank to Regional Director's Staff House, Canteen & RD's Outdoor Kitchen
- Connecting Water District Supply Line to Existing Sump Tank


Part II Installation of Water Pump and its fittings

- Fabrication and Installation of Steel Cover for Existing Sump Tank
- Painting of Steel Cover with anti-rust primer and topped with oil-based top coat paint

Cost Estimates


Description Works to be done		Quantity	unit	unit cost	Total
I	Cleaning of Existing Sump Tank				
	Job Order - Labor	1.00	l.s.		
II	Installation of Water Pump and its fittings				
	Equipment:				
	2 HP Centrifugal Pump with output head of at least 30.0m (Italy/Euro Type or equivalent)	1.00	unit		
	Materials:				
	Water District to Sump Tank				
	Brass Gate Valve, 3/4" Ø	1.00	pc		
	PE Union Patente Compression Type, 3/4" Ø	2.00	pcs		
	PE Compression Elbow, 3/4" Ø	1.00	pc		
	Float Valve, 3/4" Ø	1.00	pc		
	HDPE Pipe, SDR 11, 3/4" Ø	20.00	m		
	Pump Motor pipe fittings				
	GI Bushing reducer, 2" x 1 1/4"	1.00	pc		
	GI Nipple, 1 1/4" Ø x 6"	1.00	pc		
	GI Nipple, 1" Ø x 6"	1.00	pc		
	GI Tee 1" Ø	1.00	pc		
	GI Plug, 1" Ø	1.00	pc		

	GI Union Patente 1" Flat	1.00	pc		
	Brass Gate Valve 1" Ø	1.00	pc		
	Liquid Level Control/Float Switch	1.00	set		
	Safety Breaker	1.00	pc		
	Additional Plumbing Works				
	Compression Type Union Patente 1" Ø	1.00	pc		
	PE Tee (Compression Type), 1"Ø	1.00	pc		
	PE Coupling Reducer (Comp. Type), 1" x 1/2" Ø	1.00	pc		
	HDPE 1/2" Ø SDR 11	5.00	m		
	PE Coupling (Compression Type), 1/2" Ø	2.00	pcs		
	PE Compression Tee, 1/2" Ø	1.00	pc		
	Brass Gate Valve 1/2" Ø	2.00	pcs		
	PE Compression Elbow, 1/2" Ø	3.00	pcs		
	Teflon Tape	3.00	roll		
III	Steel Works				
	Materials:				
	MS Checkered Plate, 3mm	0.61	sq.m.		
	Round Bar 10mm Ø x 6.0m	1.00	pc		
	38mm x 38mm x 4mm thk Angle bar	1.50	length		
	Miscellaneous (Welding Rod, Blade, paints, etc.)	1.00	lot		
	Labor (35%)				
	Estimated Direct Cost				
	Indirect Cost (20% of EDC)				
	VAT (5%)				
	Total Cost				

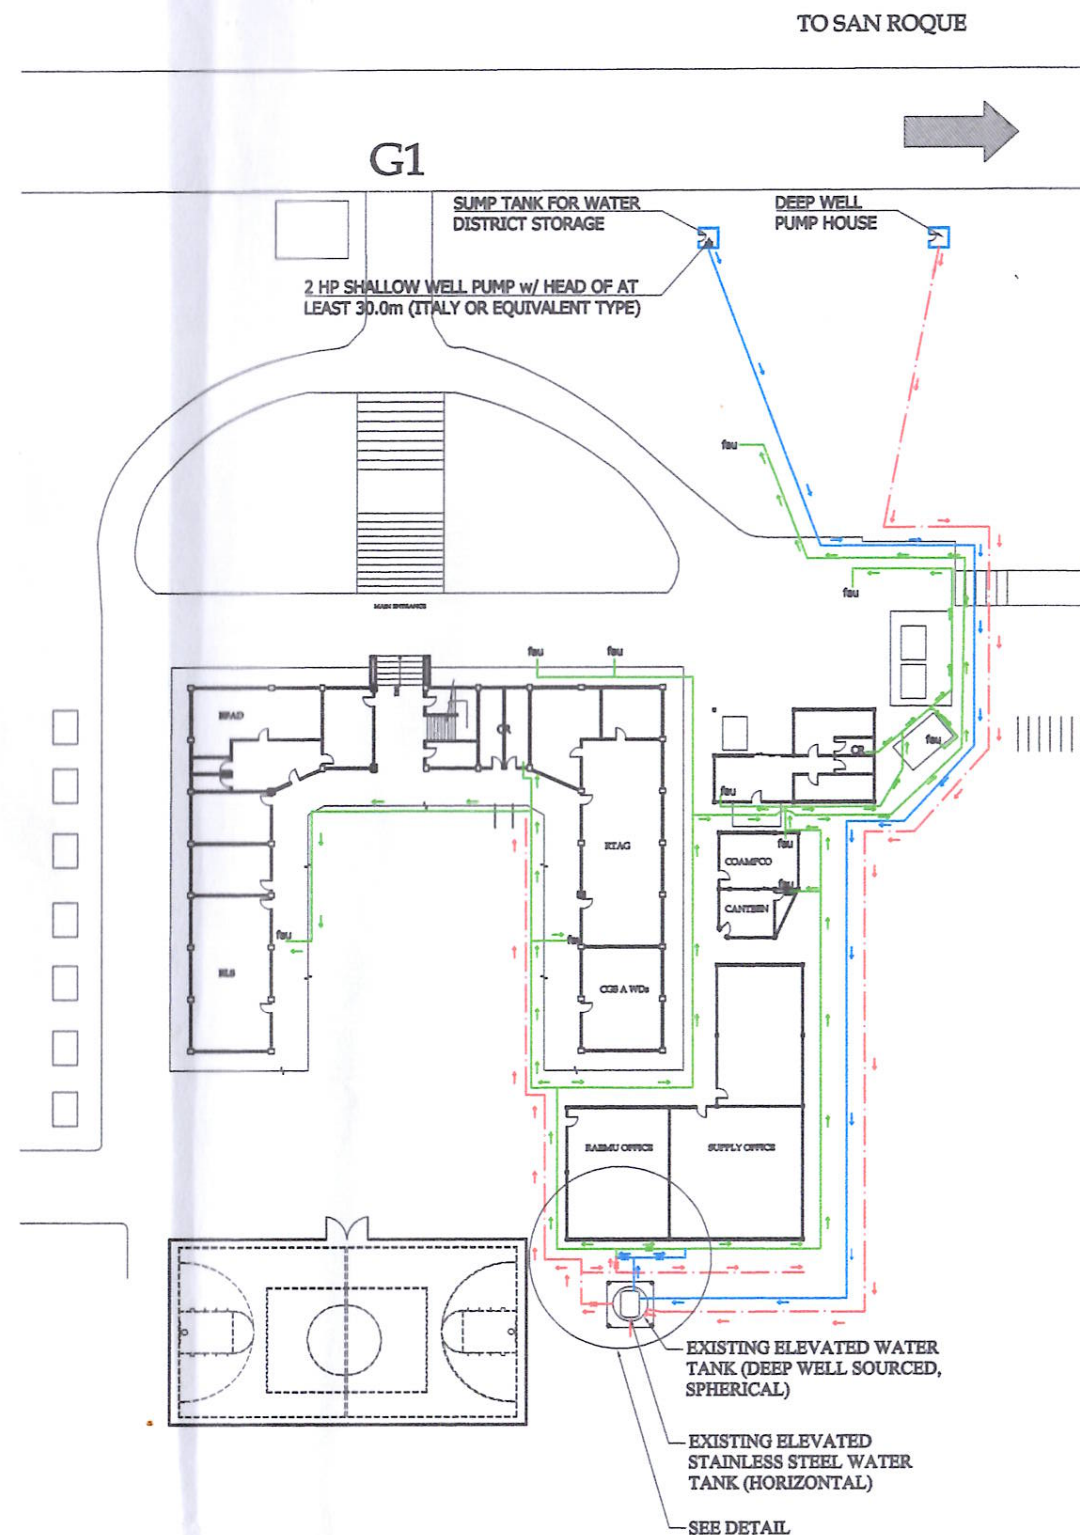


WATER SUPPLY LAYOUT PLAN

SCALE: N.T.S.

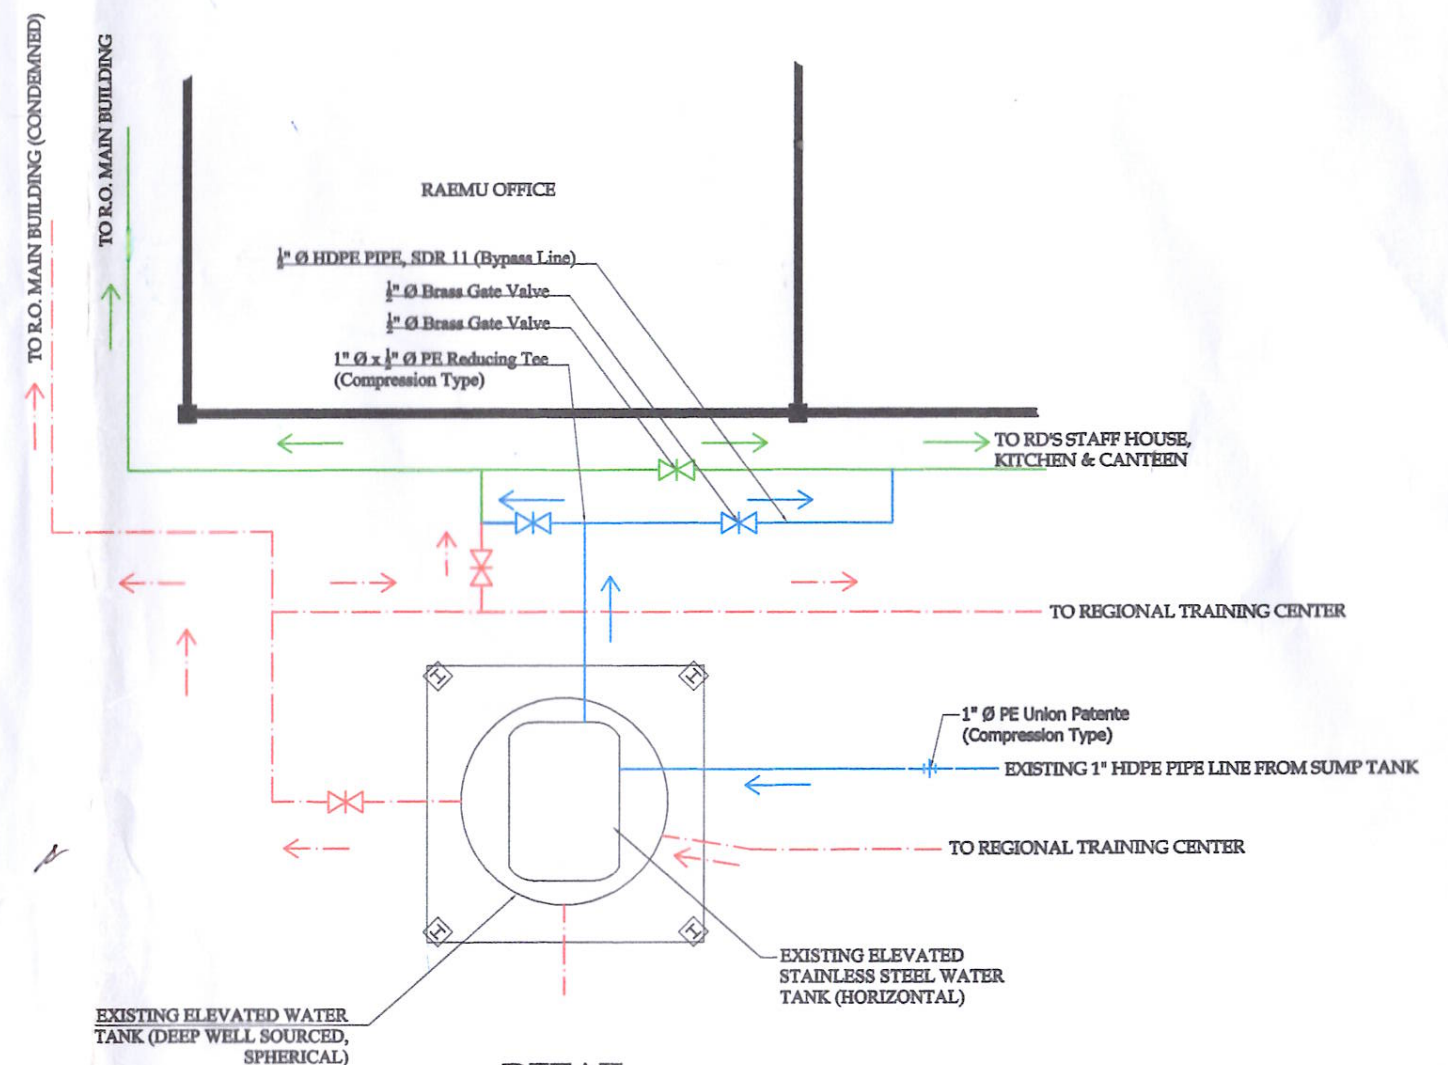


DETAIL

SCALE: N.T.S.

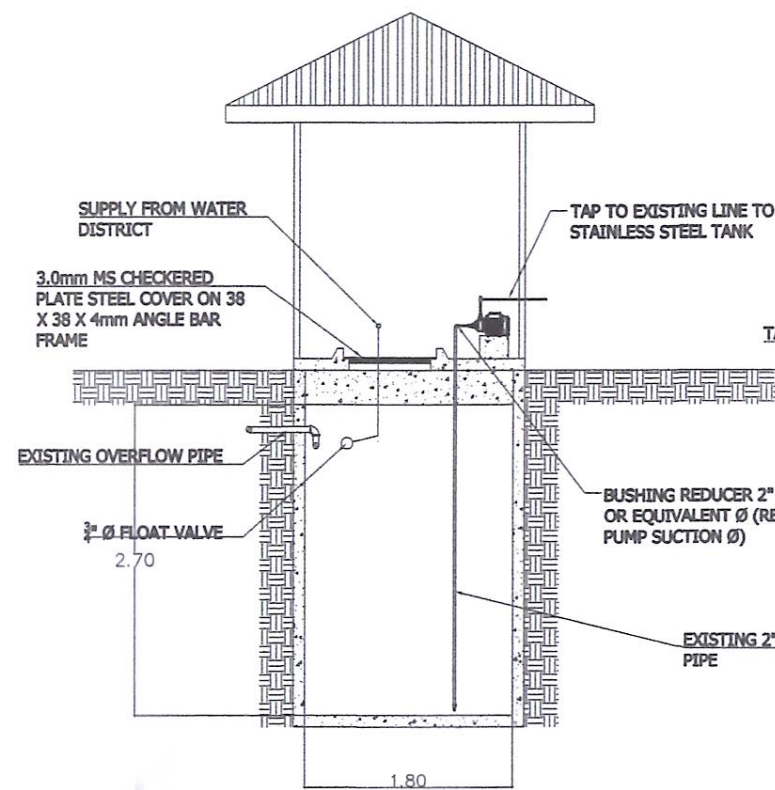


FRONT CROSS SECTIONAL VIEW

SCALE: N.T.S.

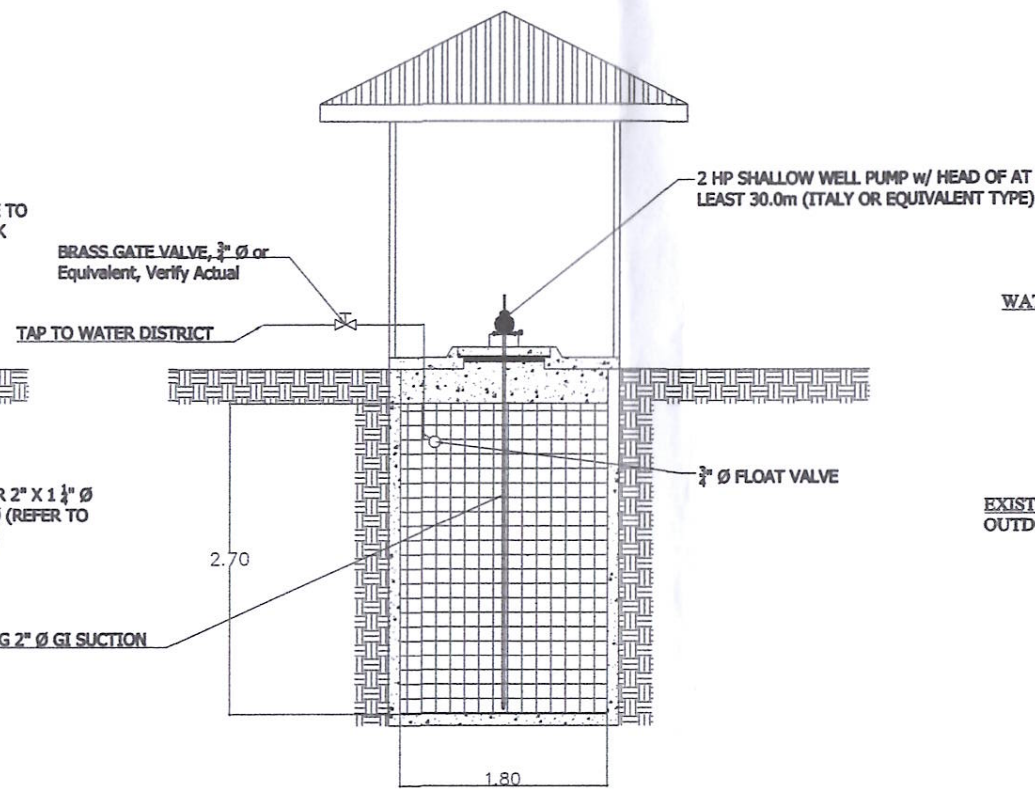


LEFT CROSS SECTIONAL VIEW

SCALE: N.T.S.

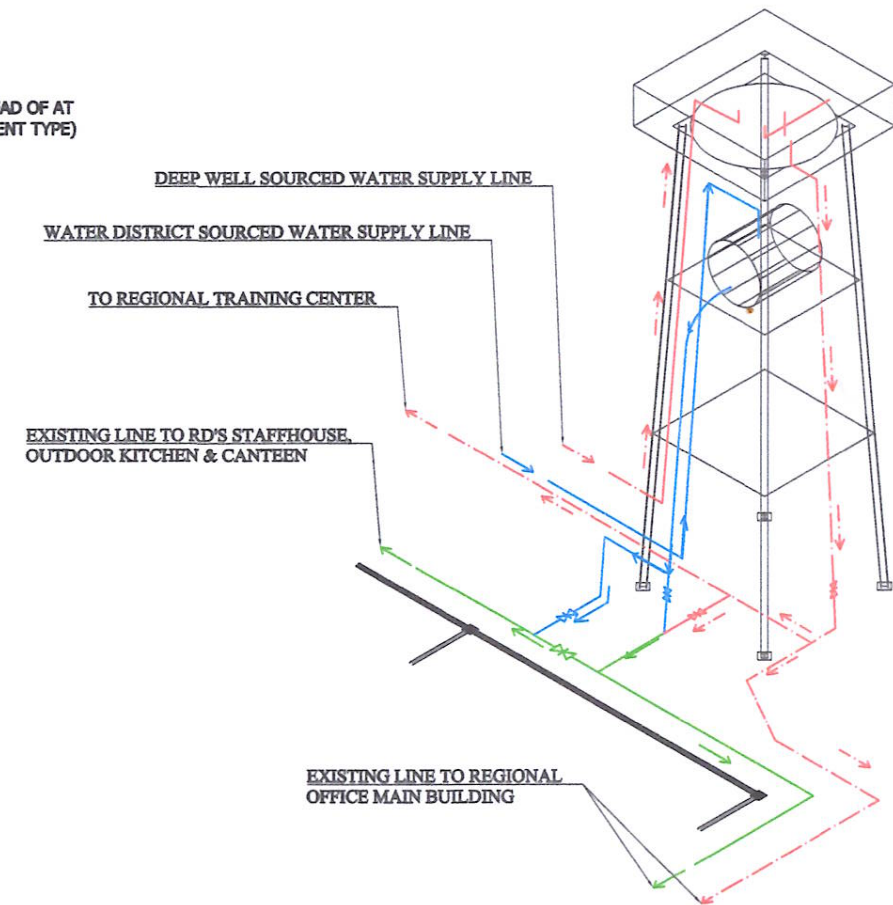


ISOMETRIC LAYOUT

SCALE: N.T.S.

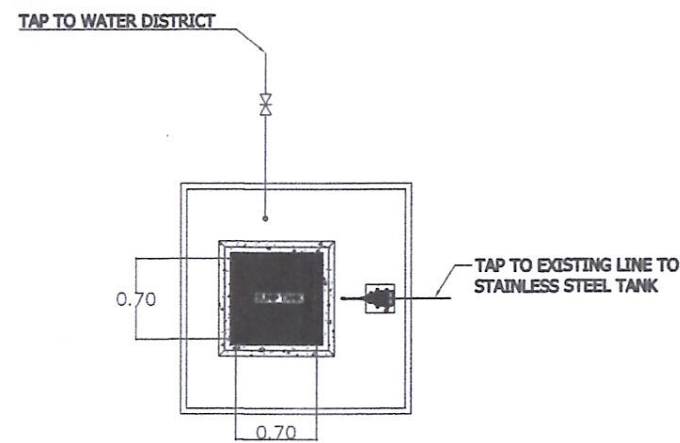


EXISTING SUMP TANK & PUMP HOUSE FLOOR PLAN

SCALE: N.T.S.

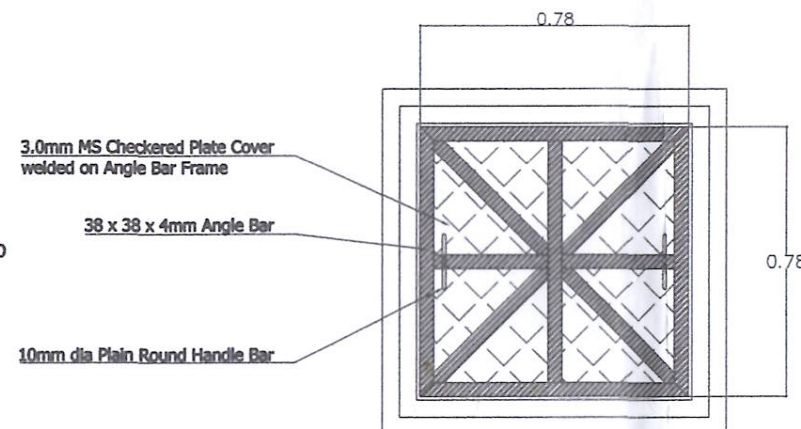

STEEL COVER DETAIL

SCALE: N.T.S.

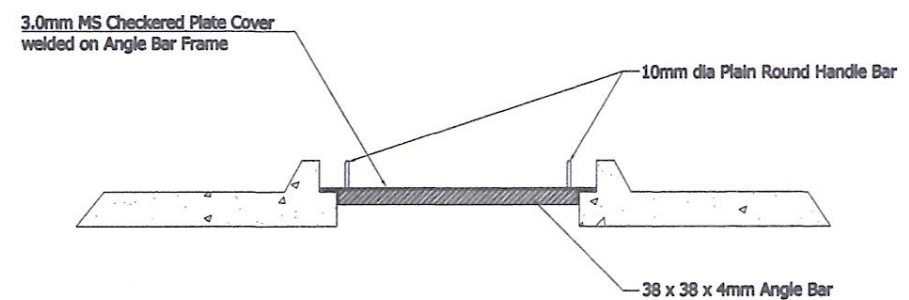

REPUBLIC OF THE PHILIPPINES
COMMISSION ON AUDIT
REGIONAL TECHNICAL AUDIT GROUP
REGIONAL OFFICE NO. IX
Cabañatuan Hills, Zamboanga City

PROJECT TITLE:

WATER SUPPLY FOR RD'S STAFFHOUSE, OUTDOOR KITCHEN & CANTEEN

LOCATION: COA-IX, CABATANGAN, ZAMBOANGA CITY

CONTENTS:

- CROSS SECTIONS
- STEEL COVER PLAN
- ISOMETRIC LAYOUT

PREPARED BY:

MARK ANTHONY M. FUNES

STAA - II

REVIEWED BY:

WILMA A. DELORIA

STAS III

RECOMMENDING APPROVAL

CHARLES R. BULAC

STAS V, SUPERVISING STAS

RECOMMENDING APPROVAL

MARISOL D. DEGASPI

OIC-DIRECTOR IV, REGIONAL DIRECTOR

SHEET NO.

2/2